


rev	By	Describe change	Date

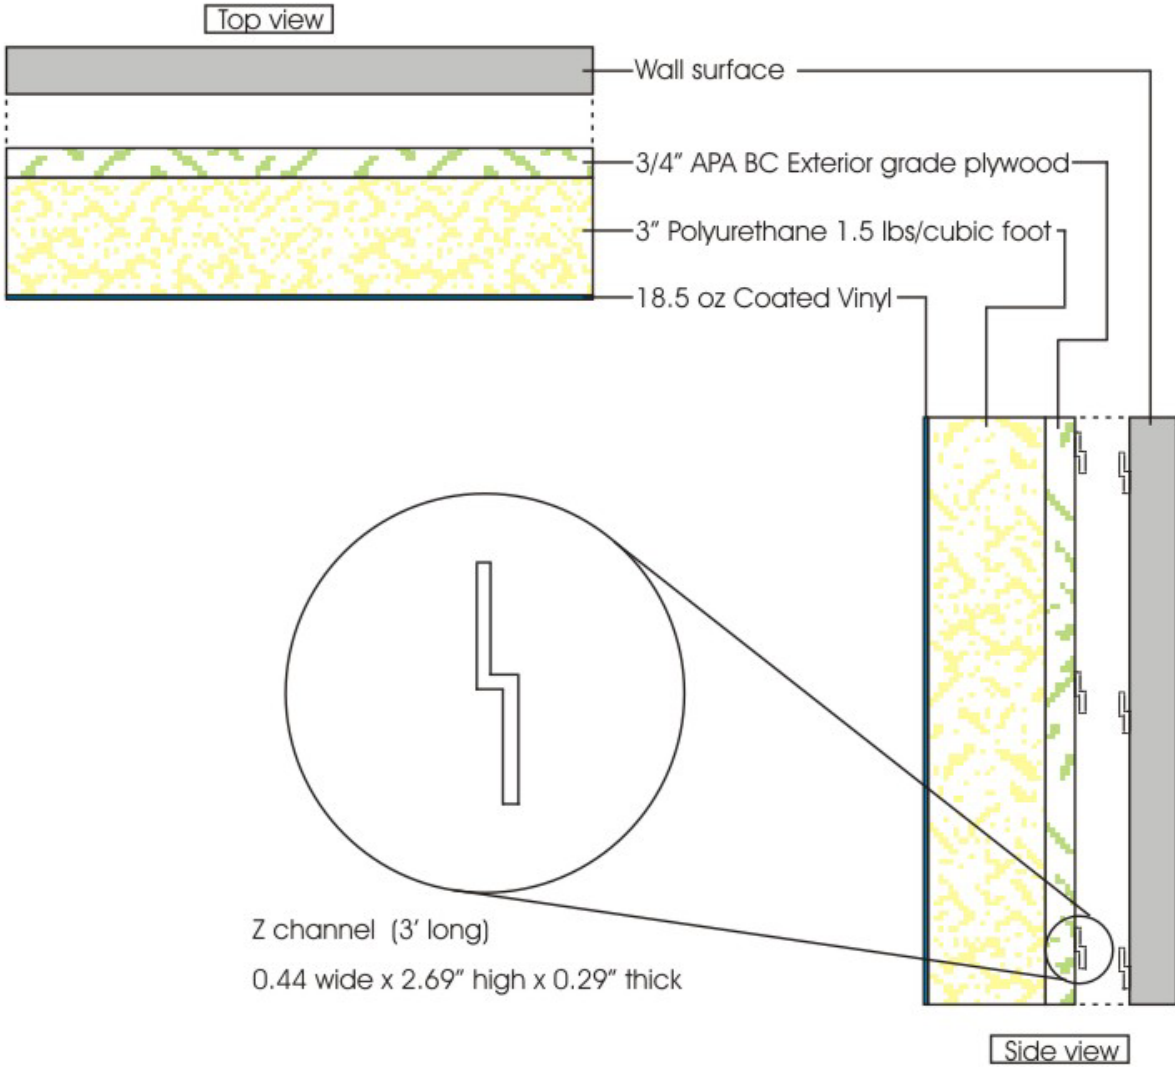

SCALE : NONE	Tolerances x. +/-0.125 unless otherwise noted	Drawn	Engineer 1	Date	01/26/05
		Title	Outdoor Stadium Padding		
		Order #	QUOTE	By	TroyR/AC
		Client	CUSTOMER	Ref.	DWG-1

Outdoor Stadium Padding Install Option